

NAI


Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@
noviaassociates.com

PROJECT: _____

CUSTOMER: _____

RSH-D

2" DEFLECTION
SPRING HANGER
RSH-D 100 10/01/05

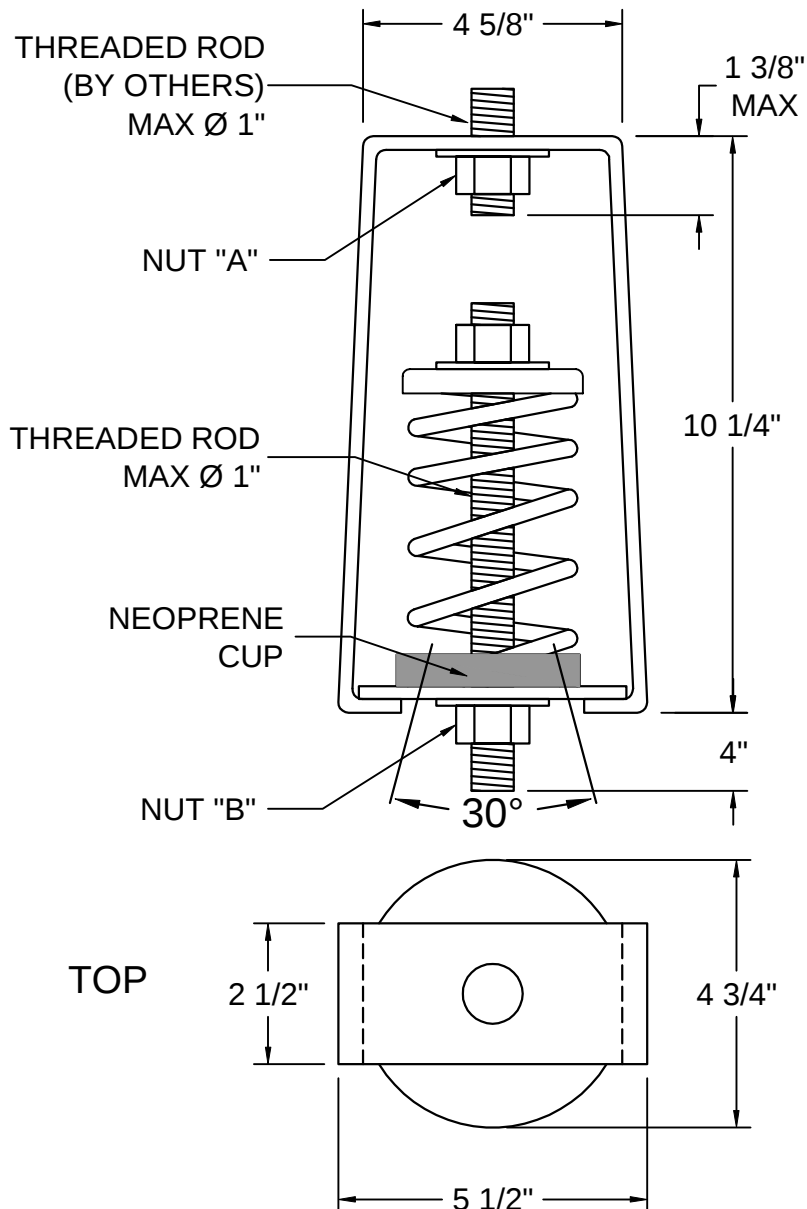

SPRING DATA

SIZE	RATED CAPAC (LBS)	RATED DEFL (IN)	SPRING CONST (LBS/IN)	COLOR
D-236	236	2.36	100	ORNG
D-352	352	2.35	150	RED
D-410	400	2.00	200	BLUE
D-624	624	2.08	300	GRN
D-840	840	2.00	420	BLK
D-1000	1000	2.00	500	GRAY

SPRING O.D.	FREE HGT	RATIO OD/OH
3.00"	5.375"	0.88 - 0.99

Threaded rod sizes shown will be used unless otherwise specified.

Hangers are pre-compressed to 65% of Rated Capacity. When hangers are under full operational load, springs should compress an additional $\frac{1}{4}" \pm$. Nut "B" and washer should be free. Loosen Nut "B" if it is not free. If pipe elevation changes (moves upwards) compensate by loosening Nut "A".

CERTIFICATION DATA

TAG _____
UNIT _____



MOUNT LOCATION PLAN VIEW

1	2
3	4
5	6
7	8
9	10

MATERIAL FOR ONE SET ____ SET(S) REQUIRED

BY: _____

DATE: _____

DWG#: _____

NAI


Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@
noviaassociates.com

PROJECT: _____

CUSTOMER: _____

RSH-D

2" DEFLECTION
SPRING HANGER
RSH-D 100 10/01/05

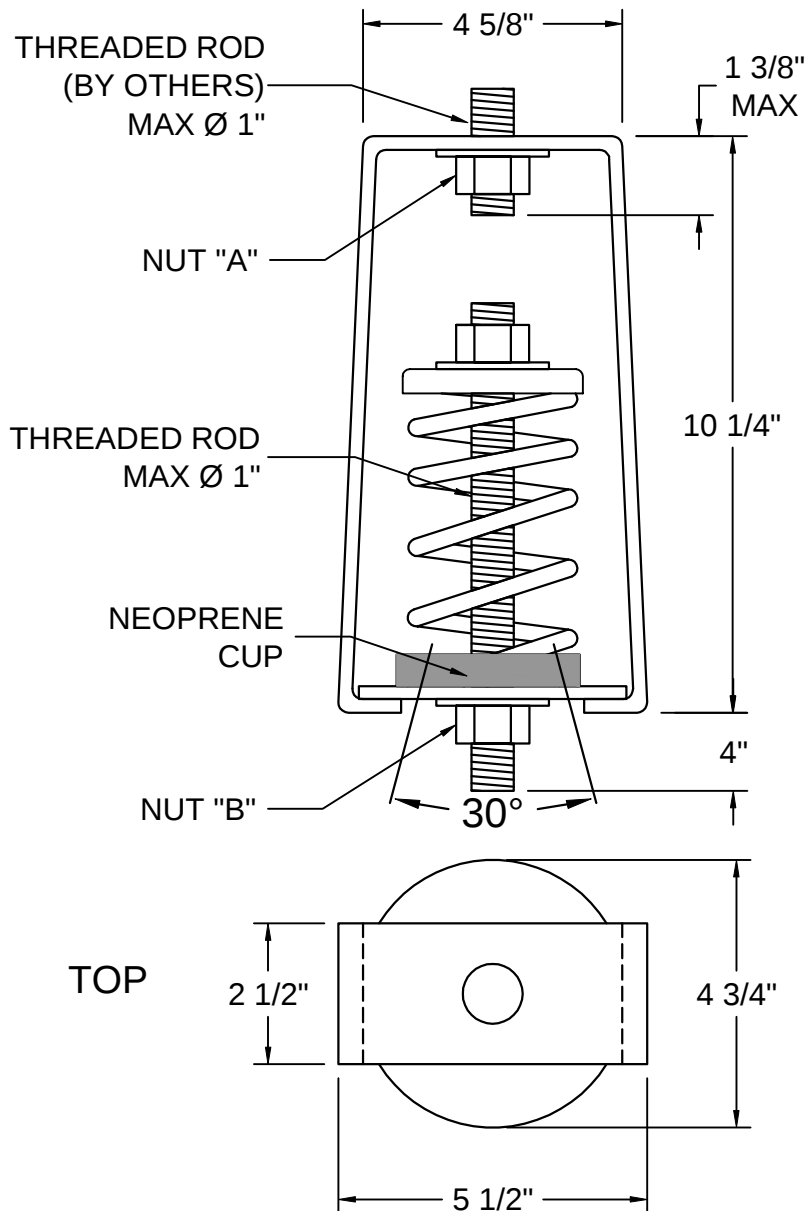

SPRING DATA

SIZE	RATED CAPAC (LBS)	RATED DEFL (IN)	SPRING CONST (LBS/IN)	COLOR
D-236	236	2.36	100	ORNG
D-352	352	2.35	150	RED
D-410	400	2.00	200	BLUE
D-624	624	2.08	300	GRN
D-840	840	2.00	420	BLK
D-1000	1000	2.00	500	GRAY

SPRING O.D.	FREE HGT	RATIO OD/OH
3.00"	5.375"	0.88 - 0.99

Threaded rod sizes shown will be used unless otherwise specified.

Hangers are pre-compressed to 65% of Rated Capacity. When hangers are under full operational load, springs should compress an additional $\frac{1}{4}" \pm$. Nut "B" and washer should be free. Loosen Nut "B" if it is not free. If pipe elevation changes (moves upwards) compensate by loosening Nut "A".

CERTIFICATION DATA

BY:

DATE:

DWG#: