




Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@noviaassociates.com

PROJECT: _____
CUSTOMER: _____

RSM-MM
0122
RESTRAINED
MARSHMELLOW MOUNT
03/15/02

LOADING					
MINIMUM			MAXIMUM		
LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)	LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)
2,180	6.80"	192/3.2	4,670	5.80"	142/2.4

MARSH MELLOW FREE HEIGHT = 8.0"

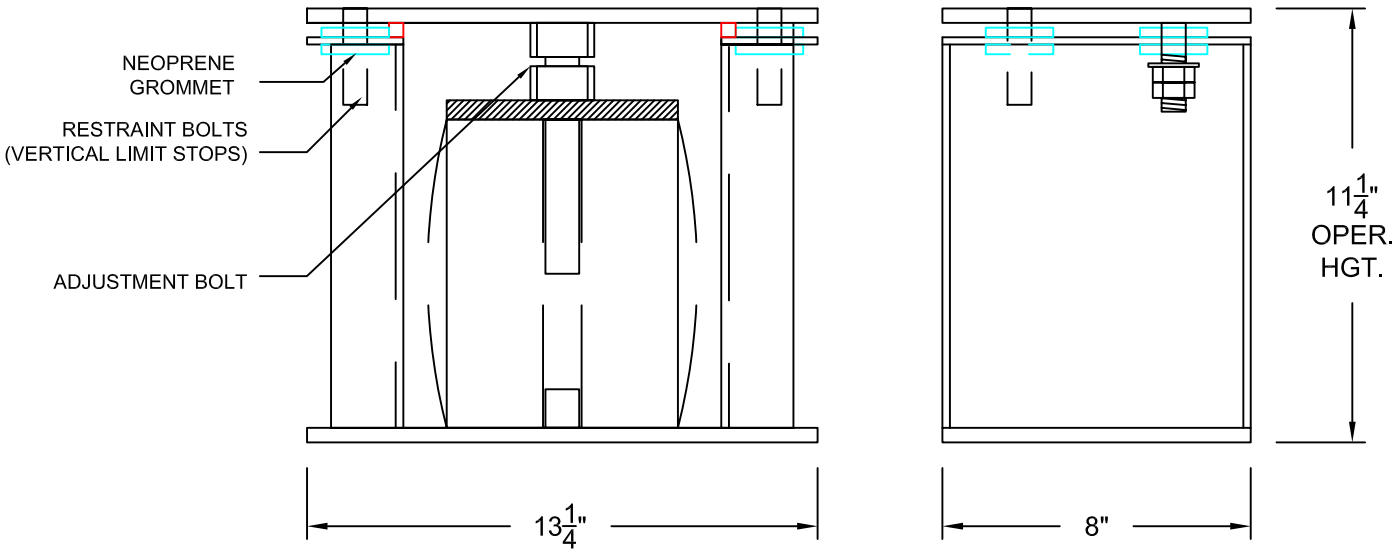

CERTIFICATION DATA

TAG _____
UNIT _____



MOUNT LOCATION PLAN VIEW

1	2
3	4
5	6
7	8
9	10

MATERIAL FOR ONE SET ____ SET(S) REQUIRED

BY:

DATE:

DWG#:



Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@
noviaassociates.com

PROJECT: _____


CUSTOMER: _____

RSM-MM
0122

RESTRAINED
MARSHMELLOW MOUNT
03/15/02

LOADING					
MINIMUM			MAXIMUM		
LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)	LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)
2,180	6.80"	192/3.2	4,670	5.80"	142/2.4

MARSH MELLOW FREE HEIGHT = 8.0"

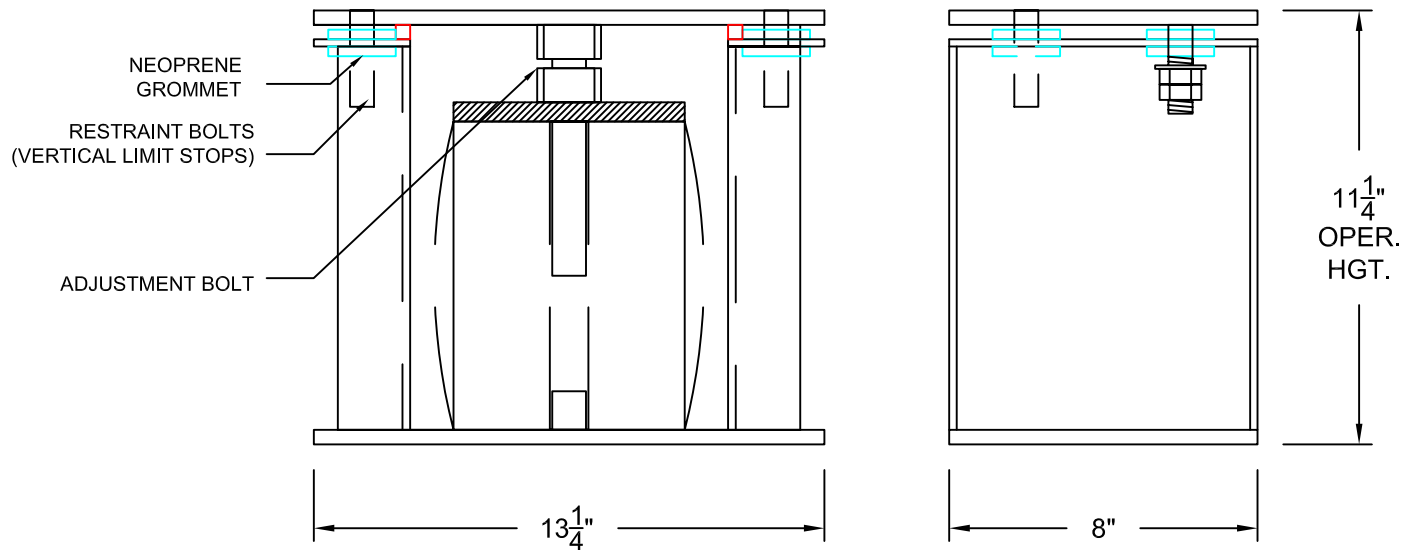

CERTIFICATION DATA

BY:

DATE:

DWG#: