




Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@noviaassociates.com

PROJECT: _____
CUSTOMER: _____


RSM-MM
0172
RESTRAINED
MARSHMELLOW MOUNT
06/22/07

LOADING					
MINIMUM			MAXIMUM		
LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)	LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)
1,400	5.10"	208/3.5	3,080	4.35"	192/3.2


MARSH MELLOW FREE HEIGHT = 6.00"

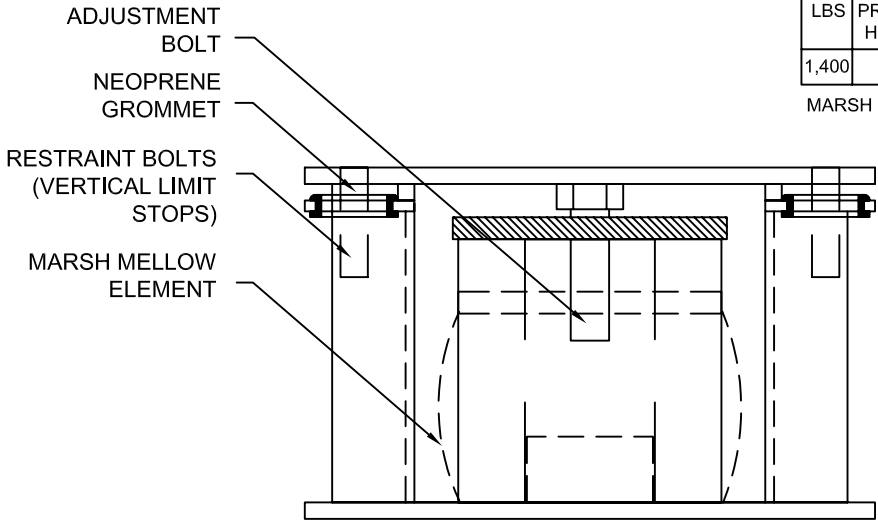

Side View

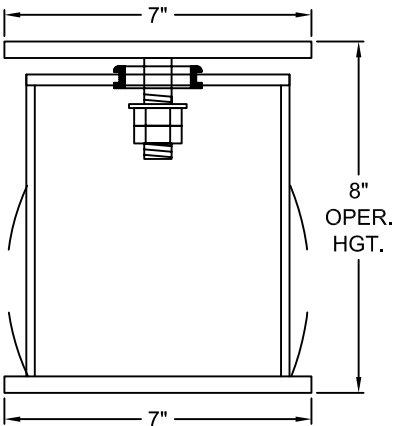


End View

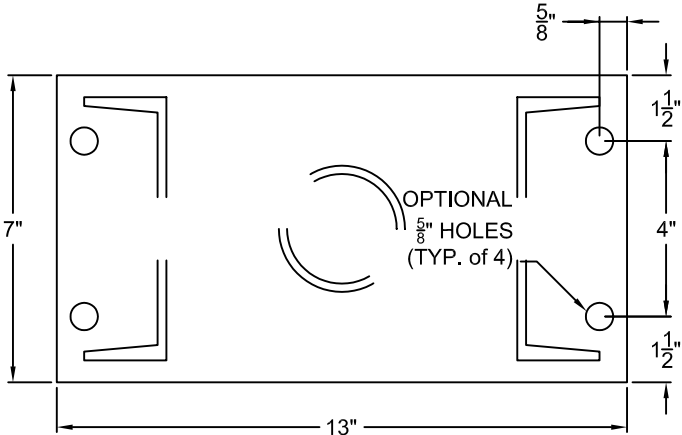

Base Plate

CERTIFICATION DATA

TAG _____
UNIT _____



MOUNT LOCATION PLAN VIEW

1	2
3	4
5	6
7	8
9	10

MATERIAL FOR ONE SET ____ SET(S) REQUIRED

BY:

DATE:

DWG#:




Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@
noviaassociates.com

PROJECT: _____

CUSTOMER: _____

RSM-MM
0172


RESTRAINED
MARSHMELLOW MOUNT
06/22/07

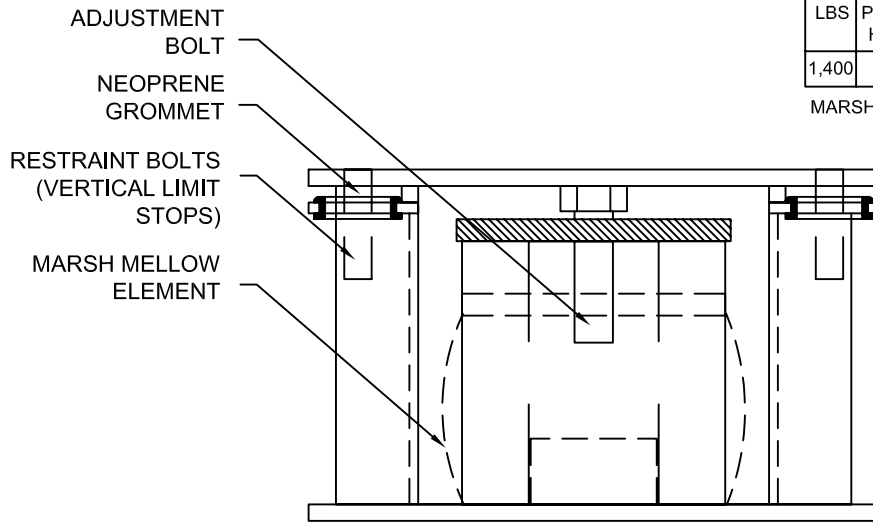


Side View

LOADING					
MINIMUM			MAXIMUM		
LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)	LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)
1,400	5.10"	208/3.5	3,080	4.35"	192/3.2

MARSH MELLOW FREE HEIGHT = 6.00"

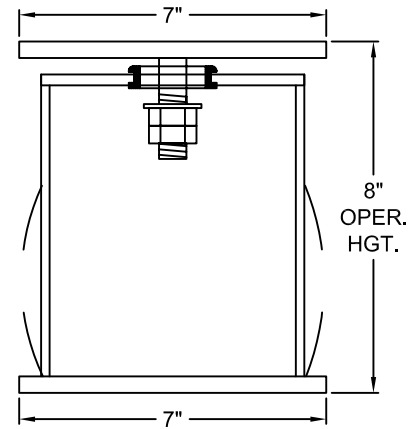

End View

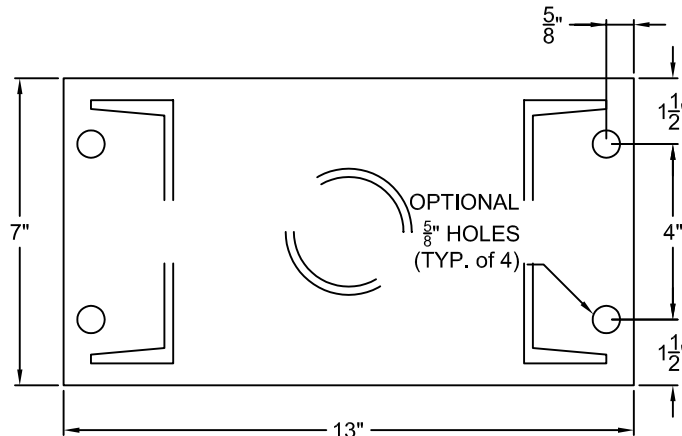

Base Plate

CERTIFICATION DATA

BY:

DATE:

DWG#: