



Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@noviaassociates.com

PROJECT: _____



CUSTOMER: _____

RSM-MM
0228



RESTRAINED
MARSHMELLOW MOUNT
03/31/03

LOADING					
MINIMUM			MAXIMUM		
LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)	LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)
2,700	10.20"	158/2.6	5,870	8.70"	116/1.9

MARSH MELLOW FREE HEIGHT = 12.00"

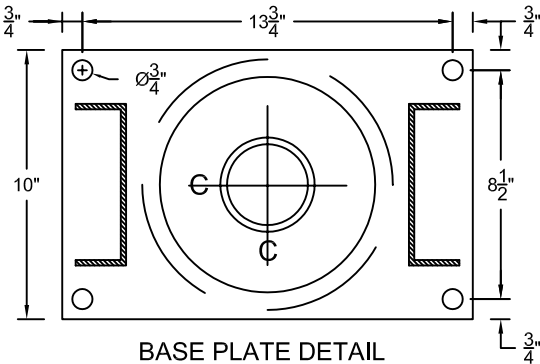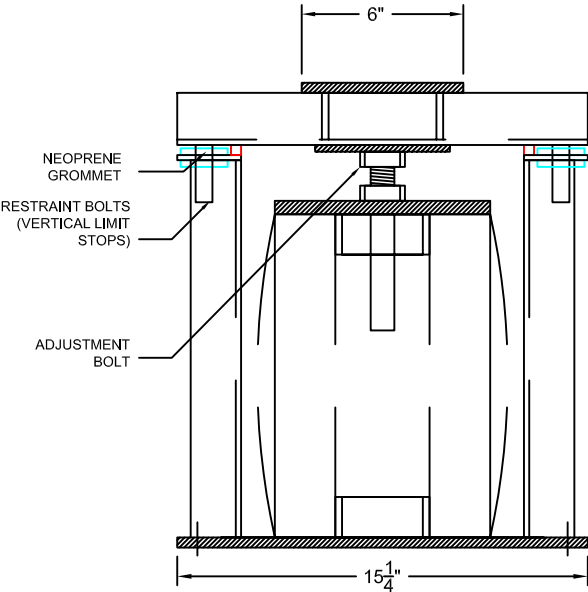


BASE PLATE DETAIL

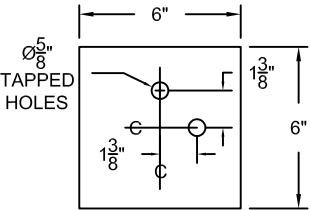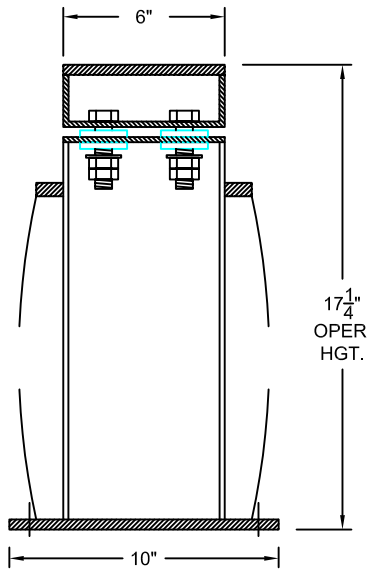

TOP PLATE DETAIL

CERTIFICATION DATA

TAG _____
UNIT _____



MOUNT LOCATION PLAN VIEW

1	2
3	4
5	6
7	8
9	10

MATERIAL FOR ONE SET _____ SET(S) REQUIRED

BY:

DATE:

DWG#:



Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@
noviaassociates.com

PROJECT: _____

CUSTOMER: _____



RSM-MM

0228



RESTRAINED
MARSHMELLOW MOUNT
03/31/03

LOADING					
MINIMUM			MAXIMUM		
LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)	LBS	COM-PRESSED HEIGHT	NATURAL FREQUENCY (CPM/Hz)
2,700	10.20"	158/2.6	5,870	8.70"	116/1.9

MARSH MELLOW FREE HEIGHT = 12.00"

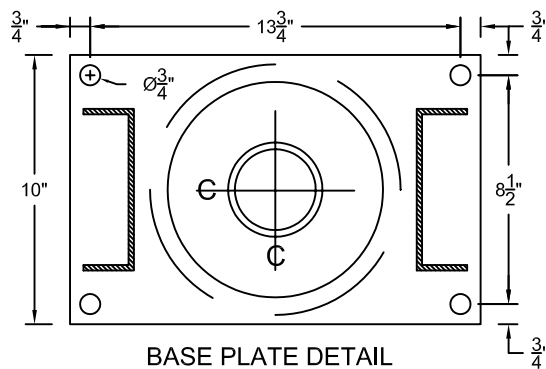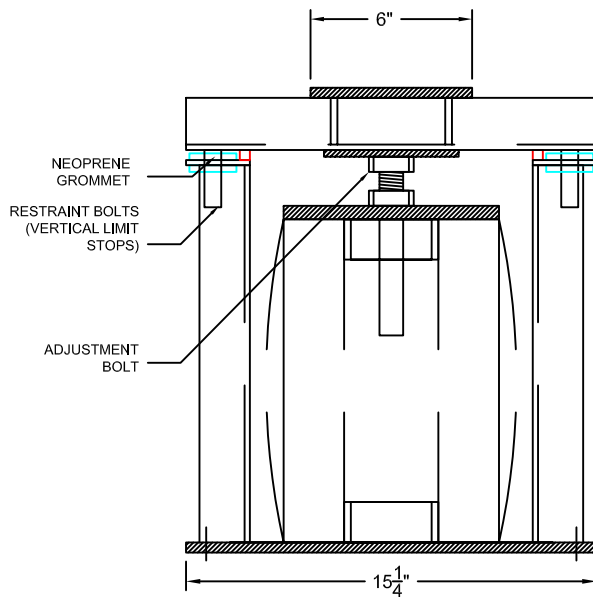

BASE PLATE DETAIL

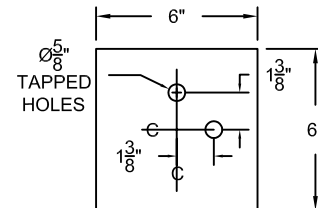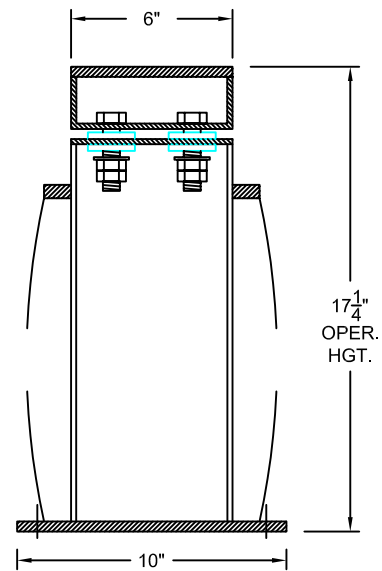

TOP PLATE DETAIL

CERTIFICATION DATA

BY:

DATE:

DWG#: