

NAI



Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@
noviaassociates.com

PROJECT: _____

CUSTOMER: _____

RSNH-2B

2" DEFLECTION
SPRING & NEOPRENE
HANGER
RSNH-2B 110 03/07/12

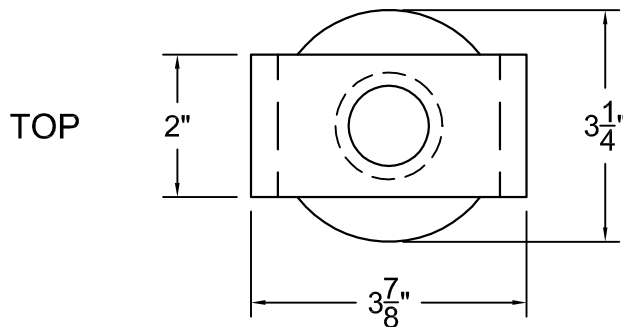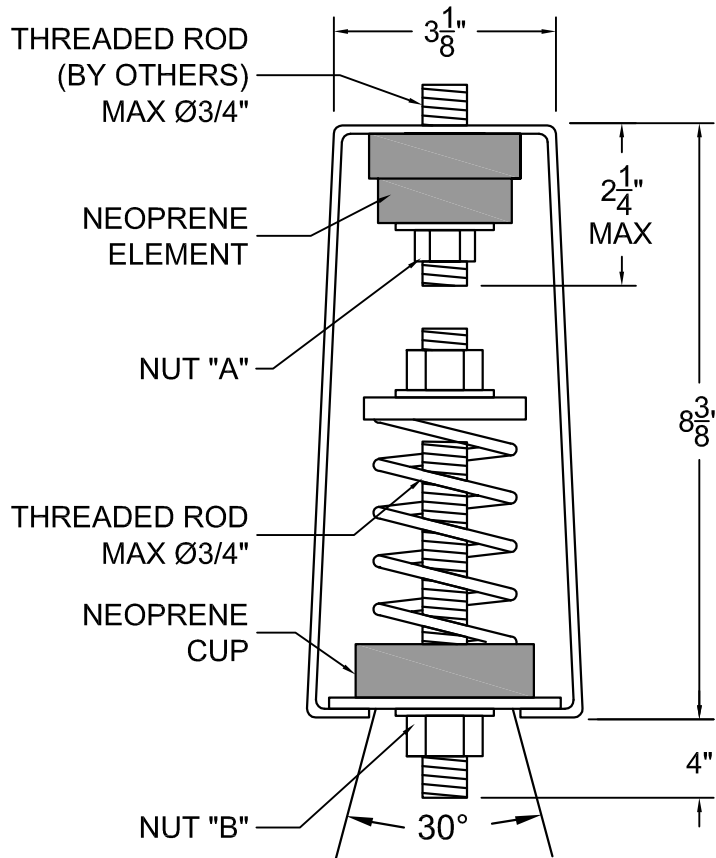

CERTIFICATION DATA

TAG _____

SPRING DATA

SIZE	RATED CAPAC (LBS)	*RATED DEFL (IN)	SPRING CONST (LBS/IN)	COLOR
2B-23	22.5	2.30	11.25	RED
2B-45	45	2.30	22.5	BLU
2B-90	90	2.30	45	GRN
2B-140	140	2.30	70	BLK
2B-200	200	2.30	100	GRAY

SPRING O.D.	FREE HGT	RATIO OD/OH
2.00"	3.68"	1.19 MIN

*Rated Deflection combines spring and neoprene element deflection

Threaded rod sizes shown will be used unless otherwise specified.

Hangers are pre-compressed to 65% of Rated Capacity. When hangers are under full operational load, springs should compress an additional $\frac{1}{4}$ " $\pm$.

Nut "B" and washer should be free. Loosen Nut "B" if it is not free. If pipe elevation changes (moves upwards) compensate by loosening Nut "A".

BY:

DATE:

DWG#: