



Novia Associates, Inc.
1 Northwestern Dr.
Salem, NH 03079
Ph: 603-898-8600
Fax: 603-898-2755
email: info@
noviaassociates.com

PROJECT: _____

CUSTOMER: _____

BOILER SEISMIC ANCHORAGE DETAIL


SD BLR-101 11/01/02

TAG _____


UNIT _____

NOTE: HK PAD INCREASED TO ALLOW FOR

3/4" PAD BONDED TO INSIDE OF CLIPS.

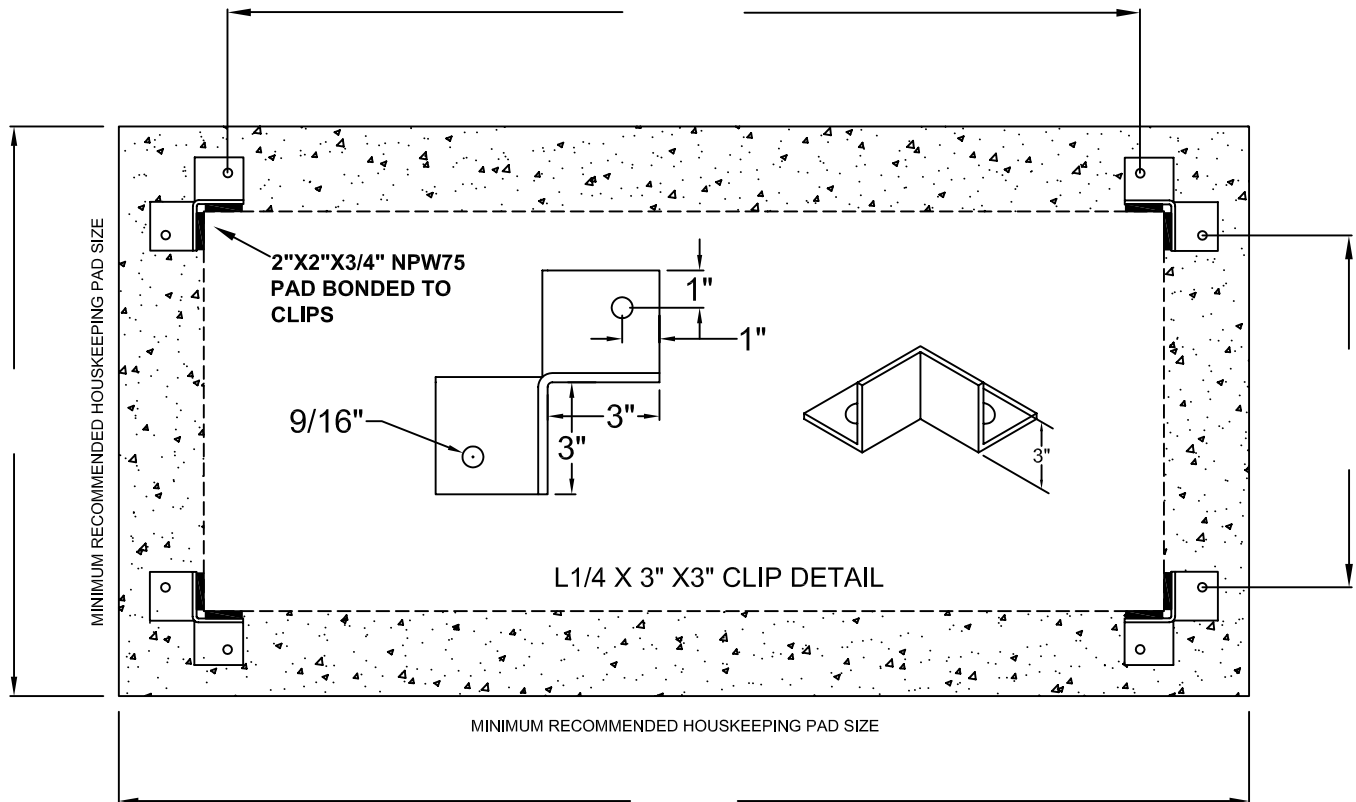

MINIMUM
EDGE
DISTANCE
(ALL SIDES)

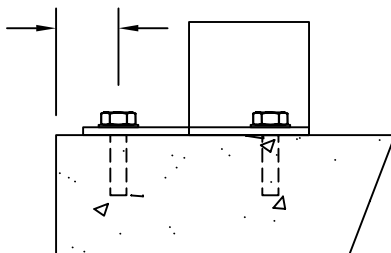

ATTACHMENT OPTIONS

- 1) _____ X _____ EMBEDMENT HILTI KBII CONCRETE ANCHORS
- 2) _____ X _____ EMBEDMENT HILTI HDI CONCRETE ANCHORS

ATTACHMENT NOTES

CLIPS MUST NOT BE ATTACHED TO UNIT SO NOT TO BYPASS
THE ISOLATION PADS. SHIM INSIDE OF CLIPS AGAINST UNIT
WITH NEOPRENE PADS.

SEE DWG#

FOR NEOPRENE PAD DETAILS.

BY:

DATE:

DWG#: